

SPARE PARTS LIST

TQ4400 TANKSCAN FIXED GAS DETECTION SYSTEM

© 2006 TQ Environmental Plc


This manual must not be copied or reproduced in part without the express written permission of TQ Environmental PLC. All information contained herein is subject to modification.

TQ Environmental Plc, Flanshaw Way, WAKEFIELD, W. Yorks, WF2 9LP
☎ 44 (0) 1924 380700; 📠 44 (0) 1924 361700; 📧 Technical@TQPLC.Com


TQ ENVIRONMENTAL PLC BS EN ISO 9001

Filename: 4826SD1
Date : 24-08-07
Author: G Thompson


OUTSIDE OF
PANEL

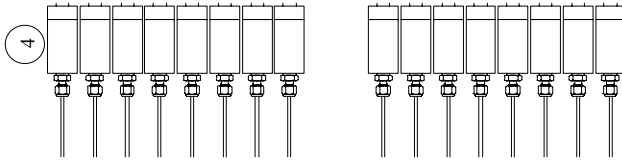


LEFT HAND SIDE PANEL

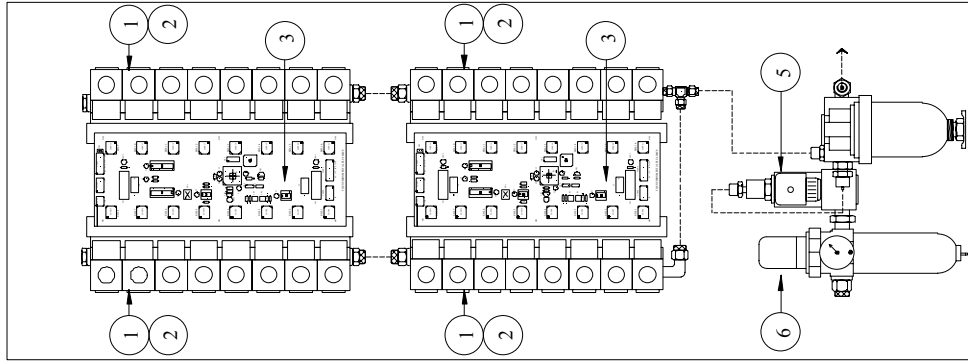










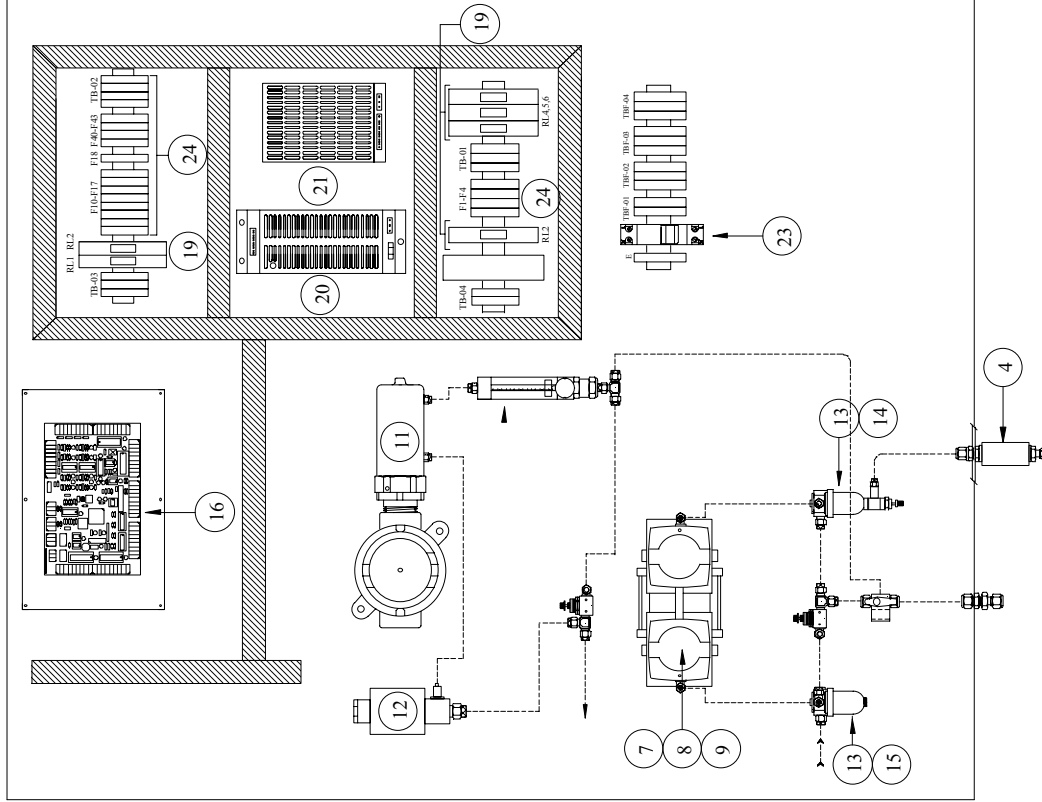














BACK PANEL

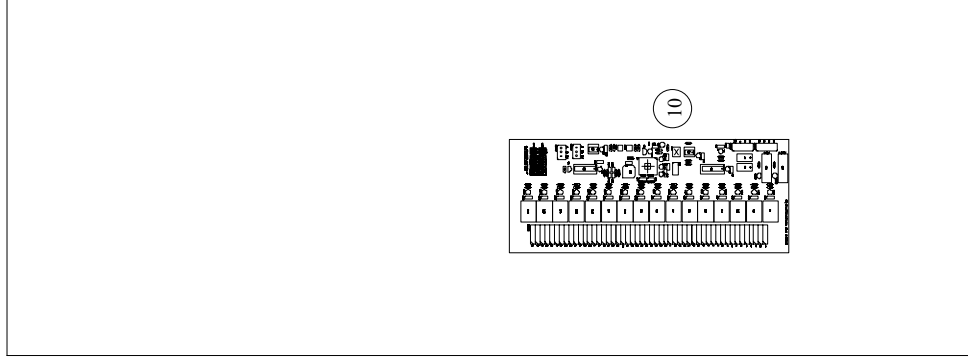

RIGHT HAND SIDE PANEL

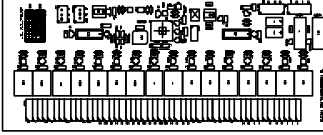

ITEM	DWG	DESCRIPTION	TQ PART NO
1		8 WAY SOLENOID BANK	920-021
2		SINGLE SOLENOID STATION FOR ABOVE 8 WAY BANK	920-097
3		SOLENOID CONTROL CARD. PLEASE QUOTE SOLENOID 1-16 or 17-32 or 33-48 when ordering	370-060
4		IN LINE FLAME ARRESTOR	914-019
5		3 WAY REVERSE PURGE SOLENOID	920-026
6		PURGE AIR REGULATOR + GAUGE	420-017 (REGULATOR) 420-017A (GAUGE)
7		DOUBLE HEAD SAMPLE PUMP 220VAC	920-099
8		SINGLE DIAPHRAGM FOR PUMP (2 REQUIRED PER PUMP)	920-002
9		SINGLE DIAPHRAGM FOR PUMP WITH VALVES, GASKET AND SCREWS (2 REQUIRED PER PUMP)	920-002A
10		RELAY OUTPUT CONTROL CARD	370-041
11		HYDROCARBON SENSOR GD129NI TARGET GAS METHANE	340-020
12		TQ 122/123 TOXIC/OXYGEN SENSOR (2 WIRE)	123-531 (OXYGEN) 123-251 (H2S)

ITEM	DWG	DESCRIPTION	TQ PART NO
13		PARTICLE/COALESCING FILTER UNIT	420-028A
14		COALESCING FILTER ELEMENT (THICK WALL) PACK OF 10	420-013
15		PARTICLE FILTER ELEMENT (THIN WALL) PACK OF 10	420-006
16		TQ4400 SETUP CONTROL BOARD	370-125
17		TQ4400 DISPLAY BOARD (LOCATED ON BACK OF DOOR)	370-126 (370-128 FOR USE WITH PRINTER)
18		INTERNAL GAS DETECTOR HYDROCARBON SENSOR (3 WIRE)	122-210 (122-013 for Test Gas Adaptor)
19		CONTROL RELAY	910-001
20		MULTIPLE OUTPUT AC-DC POWER SUPPLY	710-028 (710-028A COVER)
21		24VDC OUTPUT AC-DC POWER SUPPLY UNIT	710-030
22		SNORKEL VALVE	302-001
23		6A HBC MAIN ISOLATOR FUSE 10mm dia x 38mm long	905-008A
24		0.1, 1, 2, 3, 4A INTERNAL FUSES 5mm dia x 20mm long	905-008N = 0.1A 905-008G = 1A 905-008H = 2A 905-008I = 3A 905-008M = 4A